


REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	WAS ① 52-3/4 ② 50-3/4 ③ 18-1/4 ④ 2	19SEP98	

CONNECTING BAR  
4 REQ'D

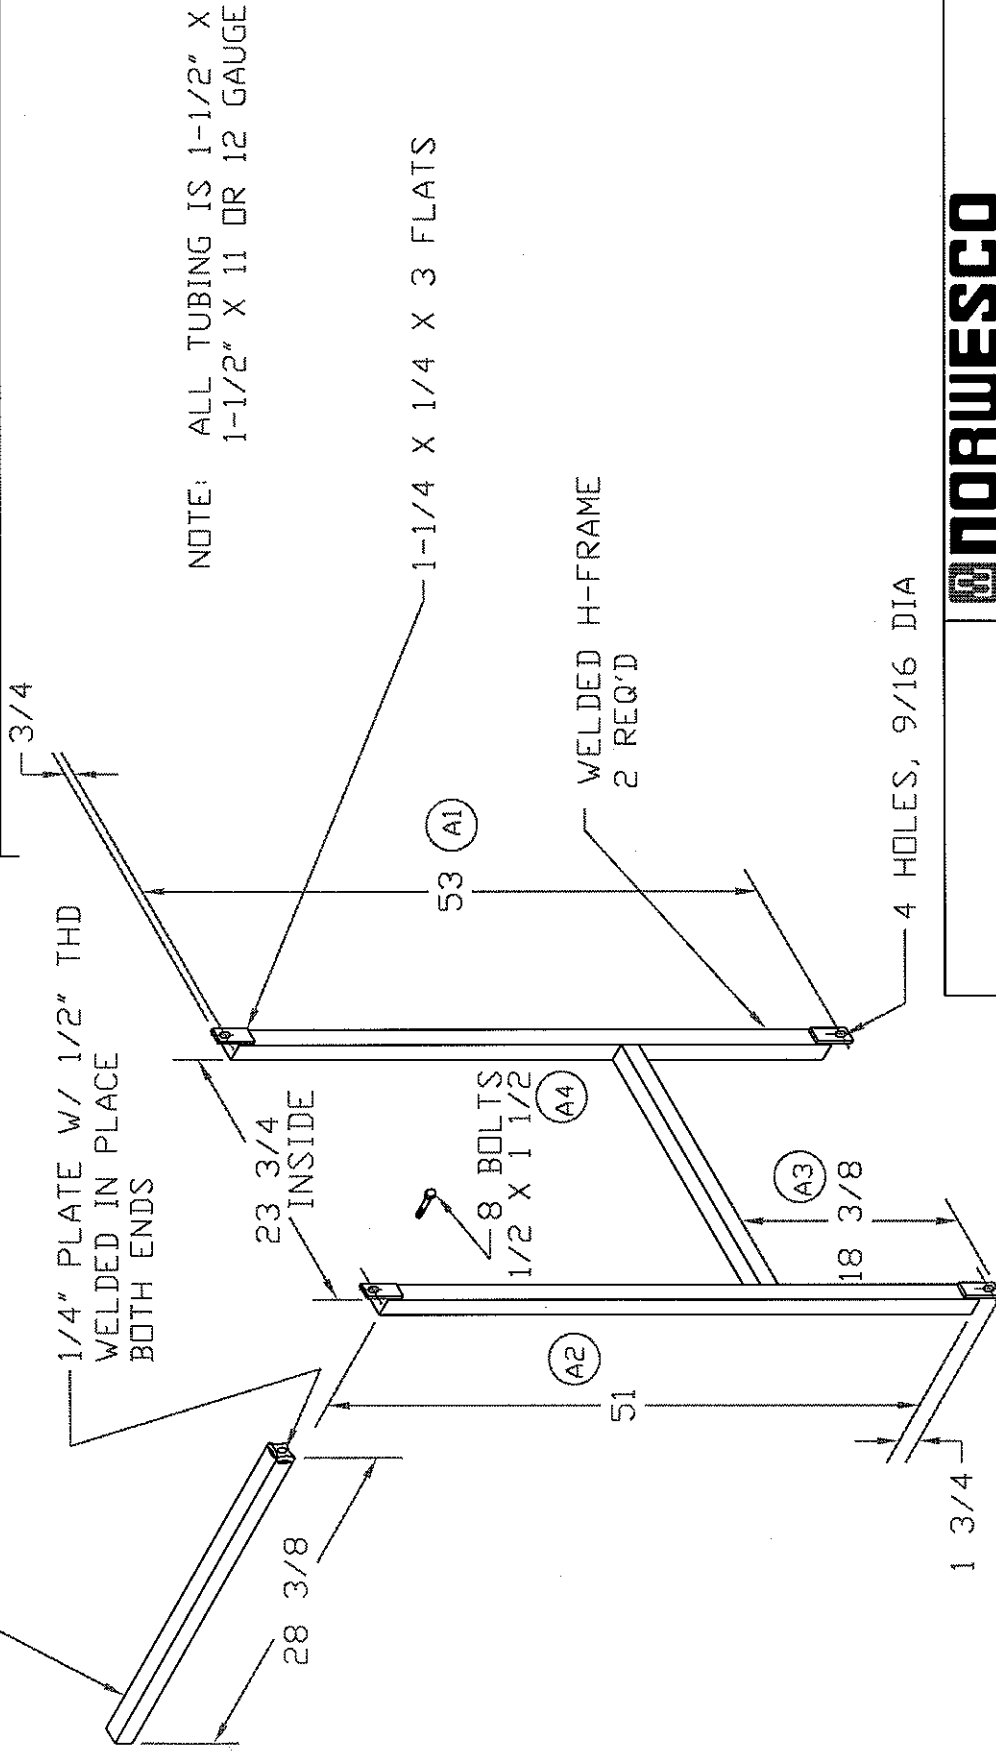

NOTE: ALL TUBING IS 1-1/2" X 1-1/2" X 11 OR 12 GAUGE

1-1/4 X 1/4 X 3 FLATS

WELDED H-FRAME  
2 REQ'D

4 HOLES, 9/16 DIA

**NORWESCO**  
ST. BONIFACIUS, MN

STEEL FRAME, 375 WATER TANK

JTP 1AUG96	SIZE A	FSCM NO.	DWG NO.	REV A
	SCALE 1/16		SHEET 2 OF 2	